


WARNING!
RISK OF FIRE OR ELECTRICAL SHOCK CAN OCCUR - DISCONNECT POWER BEFORE INSTALLING.
PLEASE ONLY USE A TRAINED CRANE ELECTRICIAN TO SET AND INSTALL.

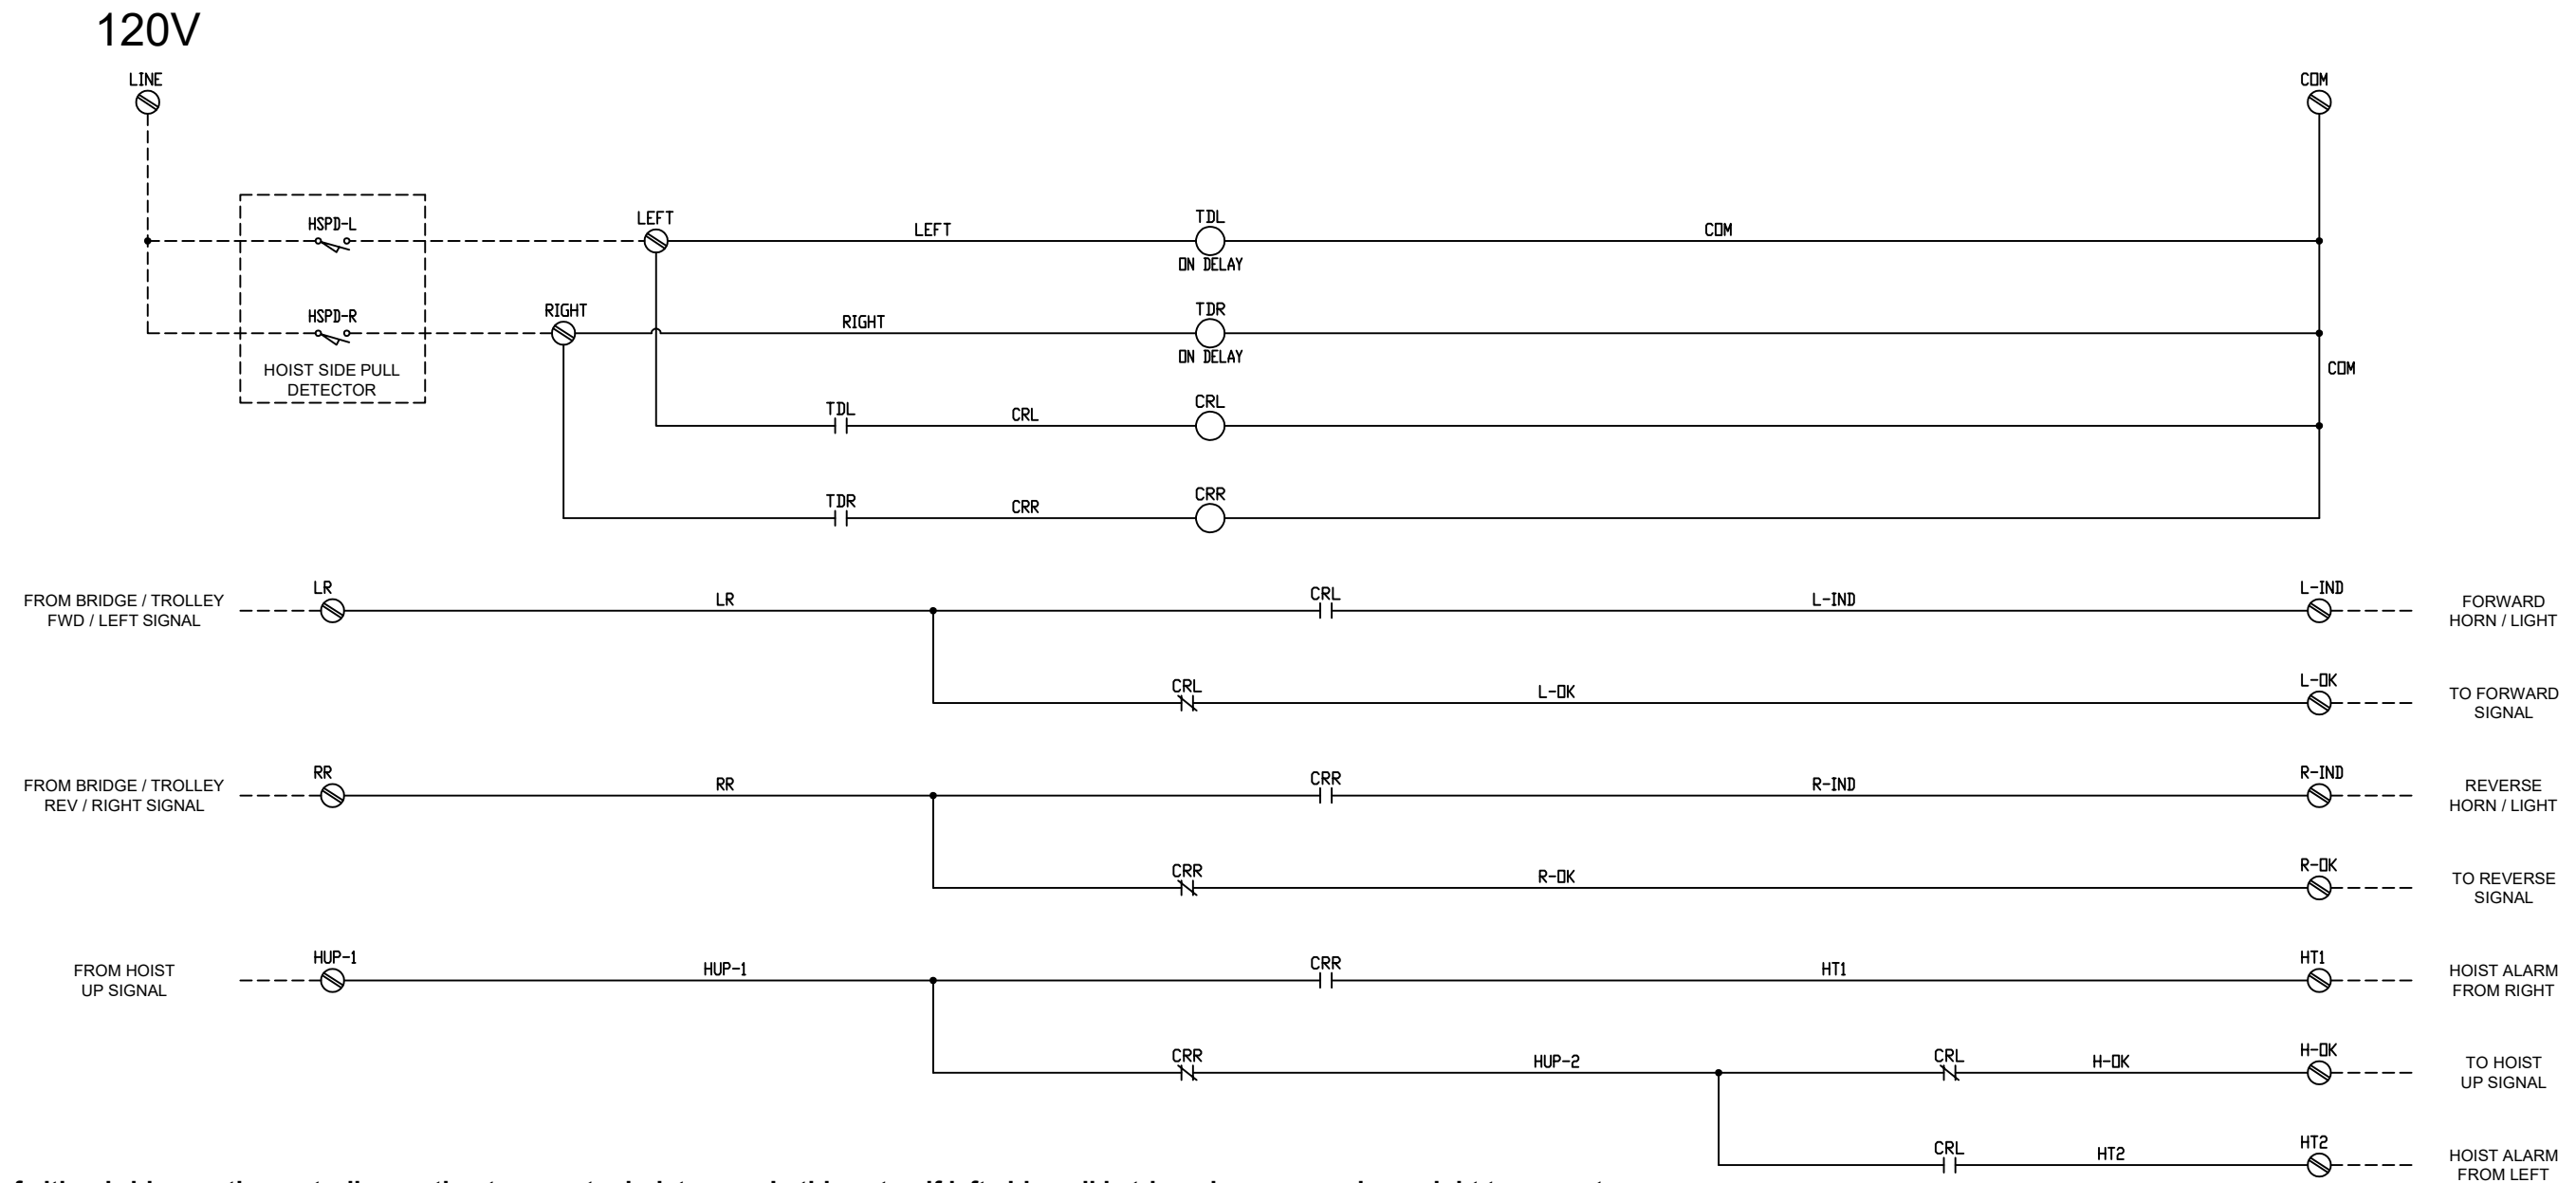

For setup of either bridge motion or trolley motion to recenter hoist.
 HSPD is for either Bridge or Trolley exclusively if not both.
 It is determined by the side pull avoidance requirement.

Left timer TDL - Normally 1 sec.
 Right timer TDR - Normally 1 sec.
 Adjust timer for nuisance trips.

Horn / Lights are recommended to alert the crane operator of a side pull.

In this setup if left side pull is tripped you can only go right to correct
 the side pull (Bridge or Trolley) same for opposite trip.

Also, the hoist is prohibited from up motion until no side pull is
 detected

(C) COPYRIGHT 2018. THIS DRAWING AND ALL INFORMATION CONTAINED IS THE PROPERTY OF INDUSTRY SOLUTIONS INTERNATIONAL, INC.

PAGE NO.: 01
DRAWN BY: CG

PANEL DESCRIPTION: HSPD TAC CONTROL

ISI Industry Solutions International, Inc.
 561-5 Plate Dr., East Dundee, IL 60118-2467 USA
 Phone: (847) 836-8844 Fax: (847) 428-9379

INDUSTRY SOLUTIONS INTERNATIONAL, INC.
 561-5 PLATE DRIVE
 EAST DUNDEE, IL. 60118
 20181205P